



# PVC Schedule 80 Takeout Dimensions

The information contained here is based on the dimensions controlled in ASTM D2467. It must be noted that these are specified as minimum dimensions. Therefore, it is advisable to verify the information here with the products to be used. The intent of this table is to assist in informing users, engineers and others. Interpretation, use, and application are a function and responsibility of the user.


**Tee & 90° Elbow**



**45° Elbow**

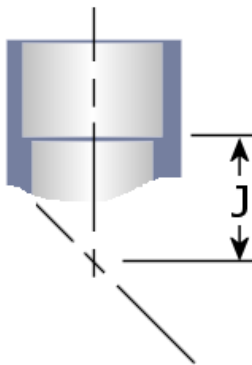

**Coupling**



Dimensions G & J are the distance from the pipe stop (socket bottom) to the intersection centerline.

Pipe Size	G	J	N
1/2	1/2	1/4	3/32
3/4	9/16	5/16	3/32
1	1-1/16	5/16	3/32
1 1/4	7/8	3/8	3/32
1 1/2	1	7/16	3/32
2	1-1/4	5/8	3/32
2 1/2	1-1/2	11/16	3/16
3	1-13/16	3/4	3/16
4	2-5/16	1	3/16
6	3-1/2	1-3/4	1/4
8	4-1/2	2	1/4
10	5-11/16	2-1/4	1/4
12	6-7/8	2-1/2	3/8

*The information provided is based on data which we believe is reliable. Expert4PVC Consulting however cannot take responsibility for the information or data contained herein and no warranty of performance for any specific purpose or particular installation of any product is expressed or implied.*